
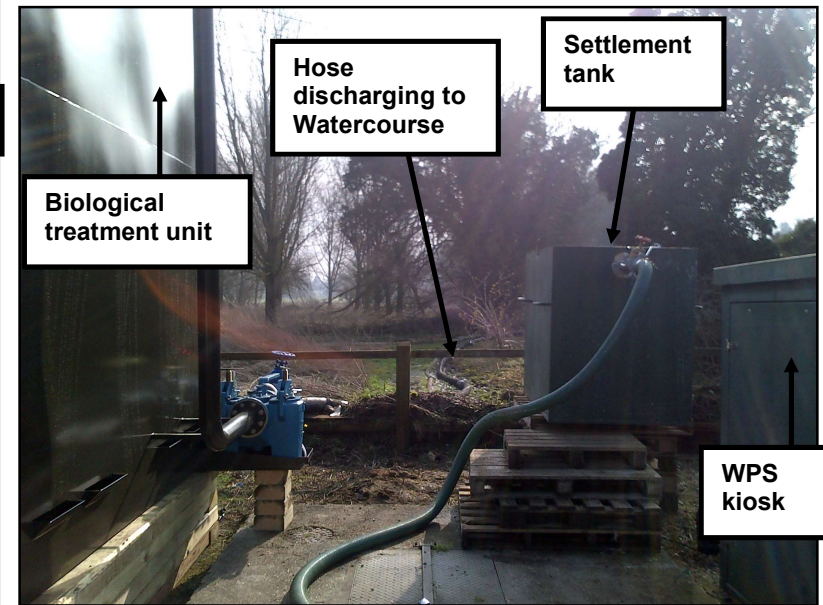


APPENDIX B


Emergency Discharge Sites

See notes in Section 4.1 regarding the potential need to modify / augment over-pumping sites to deal with future flood events. Over-pumping sites will be selected to provide the most effective arrangements to maintain services, whilst minimising environmental effects. Where practical, sites that have been used previously are expected to be re-used (when necessary), but the use of different locations cannot be ruled out, if hydraulic conditions dictate.

Fyfield, Hampshire - Overpumping Site. Photos from Winter of 2013-14

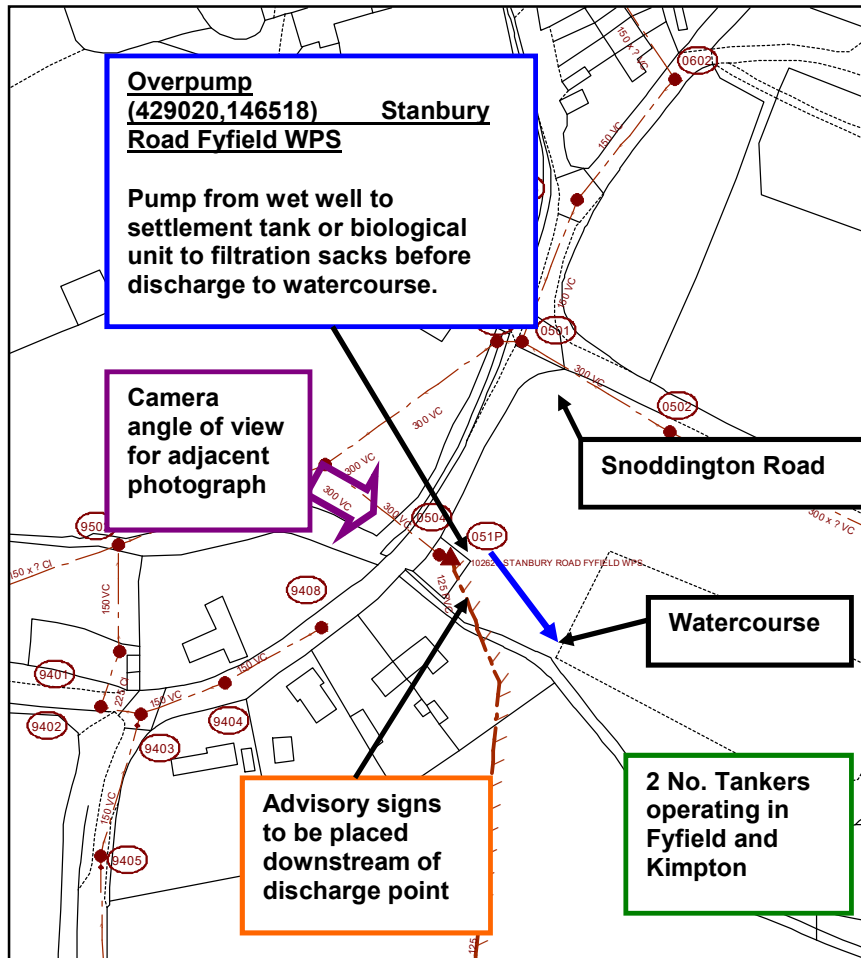


Kimpton, Hampshire - Overpumping Site. Photos from Winter of 2013-14

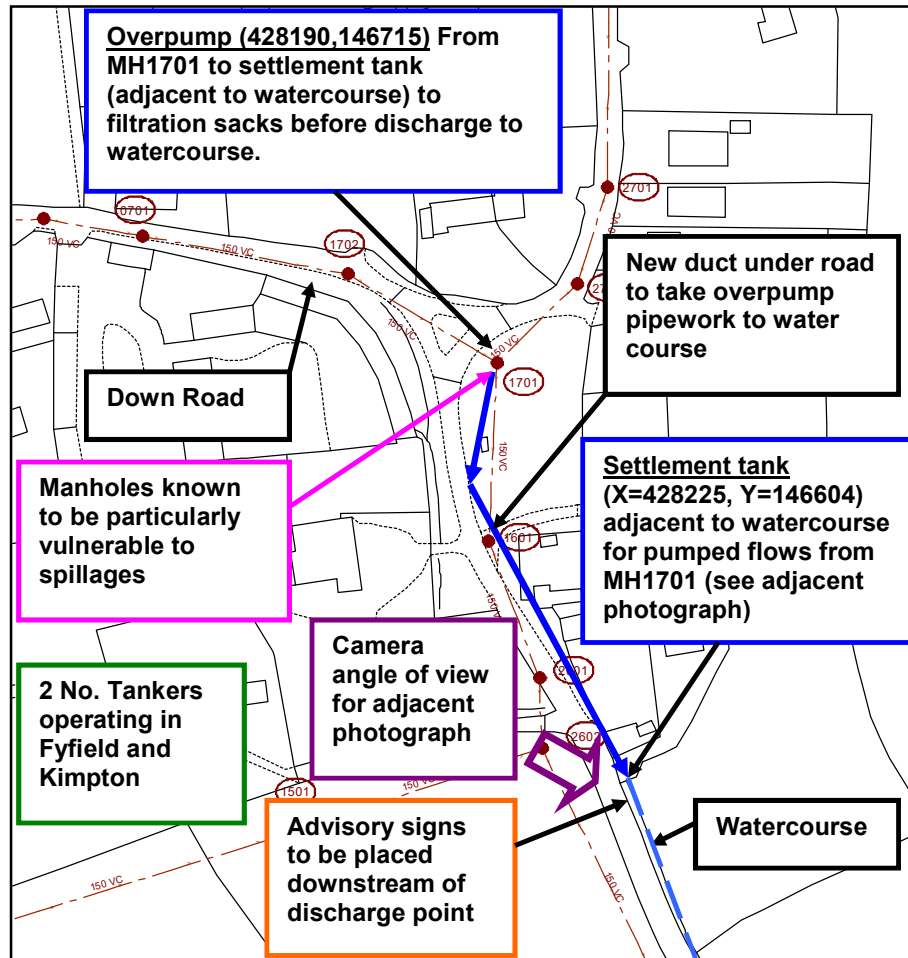

Photograph taken of settlement tank in February 2013 which was at same location as tank used in winter of 2013/14



Thruyton (Mullen's Pond), Hampshire - Overpumping and Tankering Sites. Photos from Winter of 2013-14

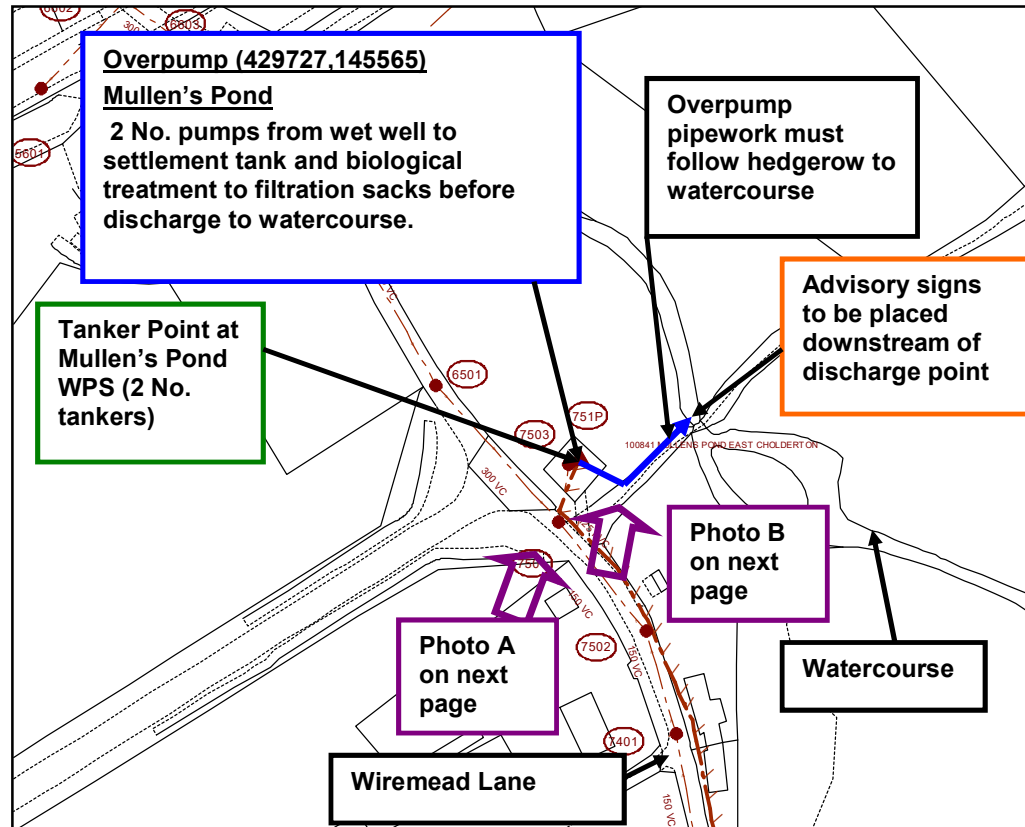

Thruxton (Mullen's Pond), Hampshire - Overpumping and Tankering Sites. Photos from Winter of 2013-14

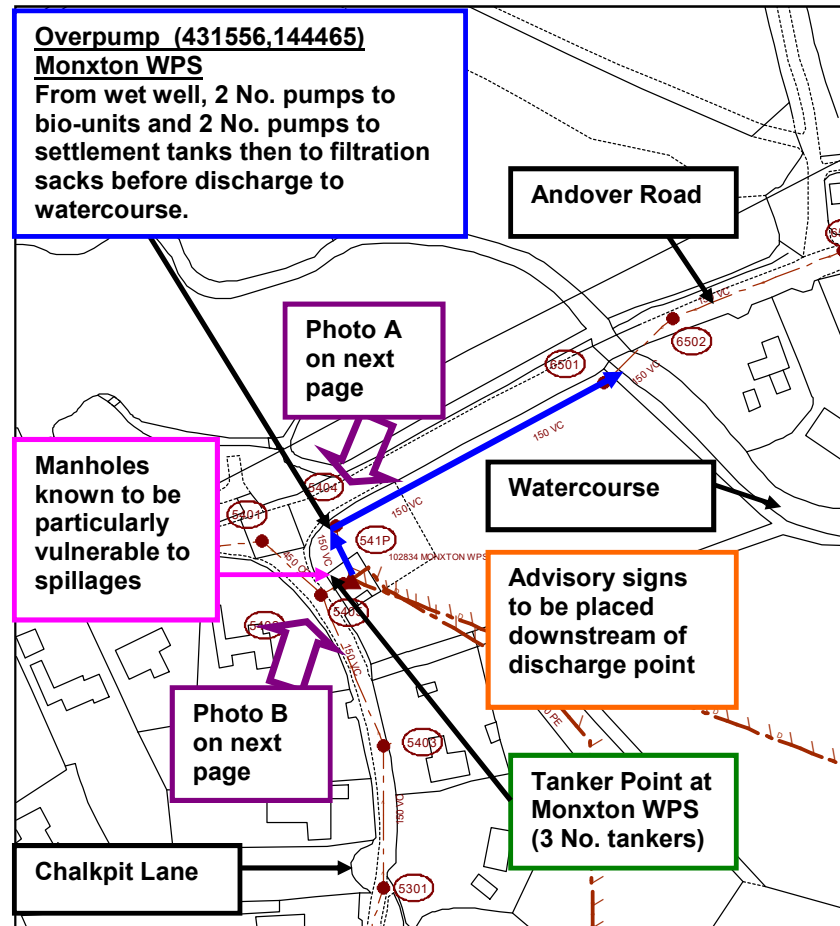


Photo A – Mullen's Pond WPS compound



Photo B – Mullen's Pond WPS compound

Monxton, Hampshire - Overpumping and Tankering Sites Photos from Winter of 2013-14



Monxton, Hampshire - Overpumping and Tankering Sites. Photos from Winter of 2013-14


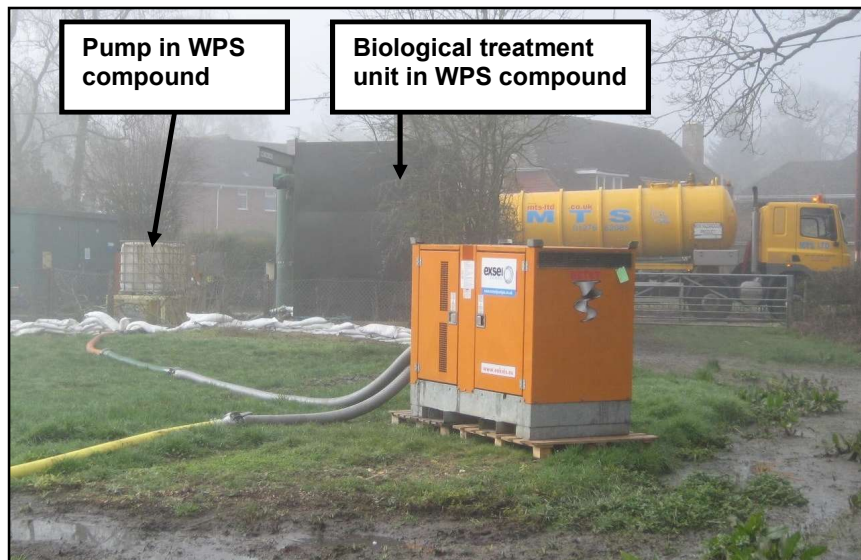


Photo A – Pump in field adjacent to Monxton WPS



Photo B – Biological treatment unit in compound

Amport, Hampshire - Overpumping and Tankering Sites. Photos from Winter of 2013-14

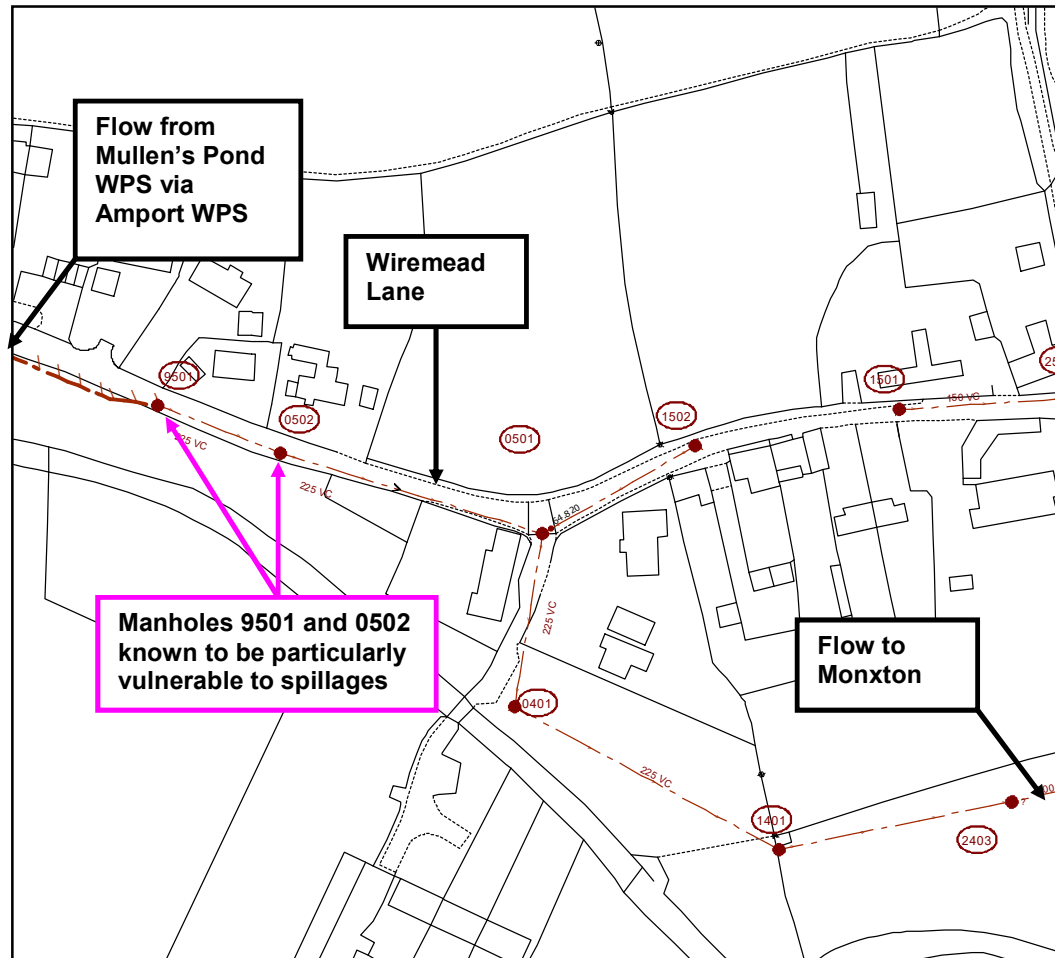

Timing for Deployment of Tankers and Overpumps in the Winters of 2013-14 to 2020-21

Location	Tankering			Overpumping		
	Start Date	Stop Date	Typical Number of Tankers	Start Date	Stop Date	Typical Number of Pumps
Fyfield and Kimpton	21/01/14	11/03/14	2	05/02/14	03/07/14	2
Monxton	17/01/14	25/03/14	3	07/03/14	22/04/14	4
Thrupton (Mullen's Pond)	9/01/14	16/03/14	2	04/02/14	23/06/14	2
Kimpton	15/02/2021	02/04/2021	2	Not used.		
Fyfield	05/01/2021	28/04/2021	2	Not used.		
Mullen's Pond	04/12/2020	12/04/2021	4*	Not used.		
Little Ann Bridge	12/12/2020	27/04/2021	6	Not used.		

* Note: - The ultraviolet (UV) treatment plant was switched on at Mullen's Pond on the 9th April 2021 but the tanker was kept on site for the weekend to ensure SW had confidence in the UV plant which was turned off on the 25th May 2021.